




THE CITY OF SAN DIEGO
General Plan
Program Environmental
Impact Report



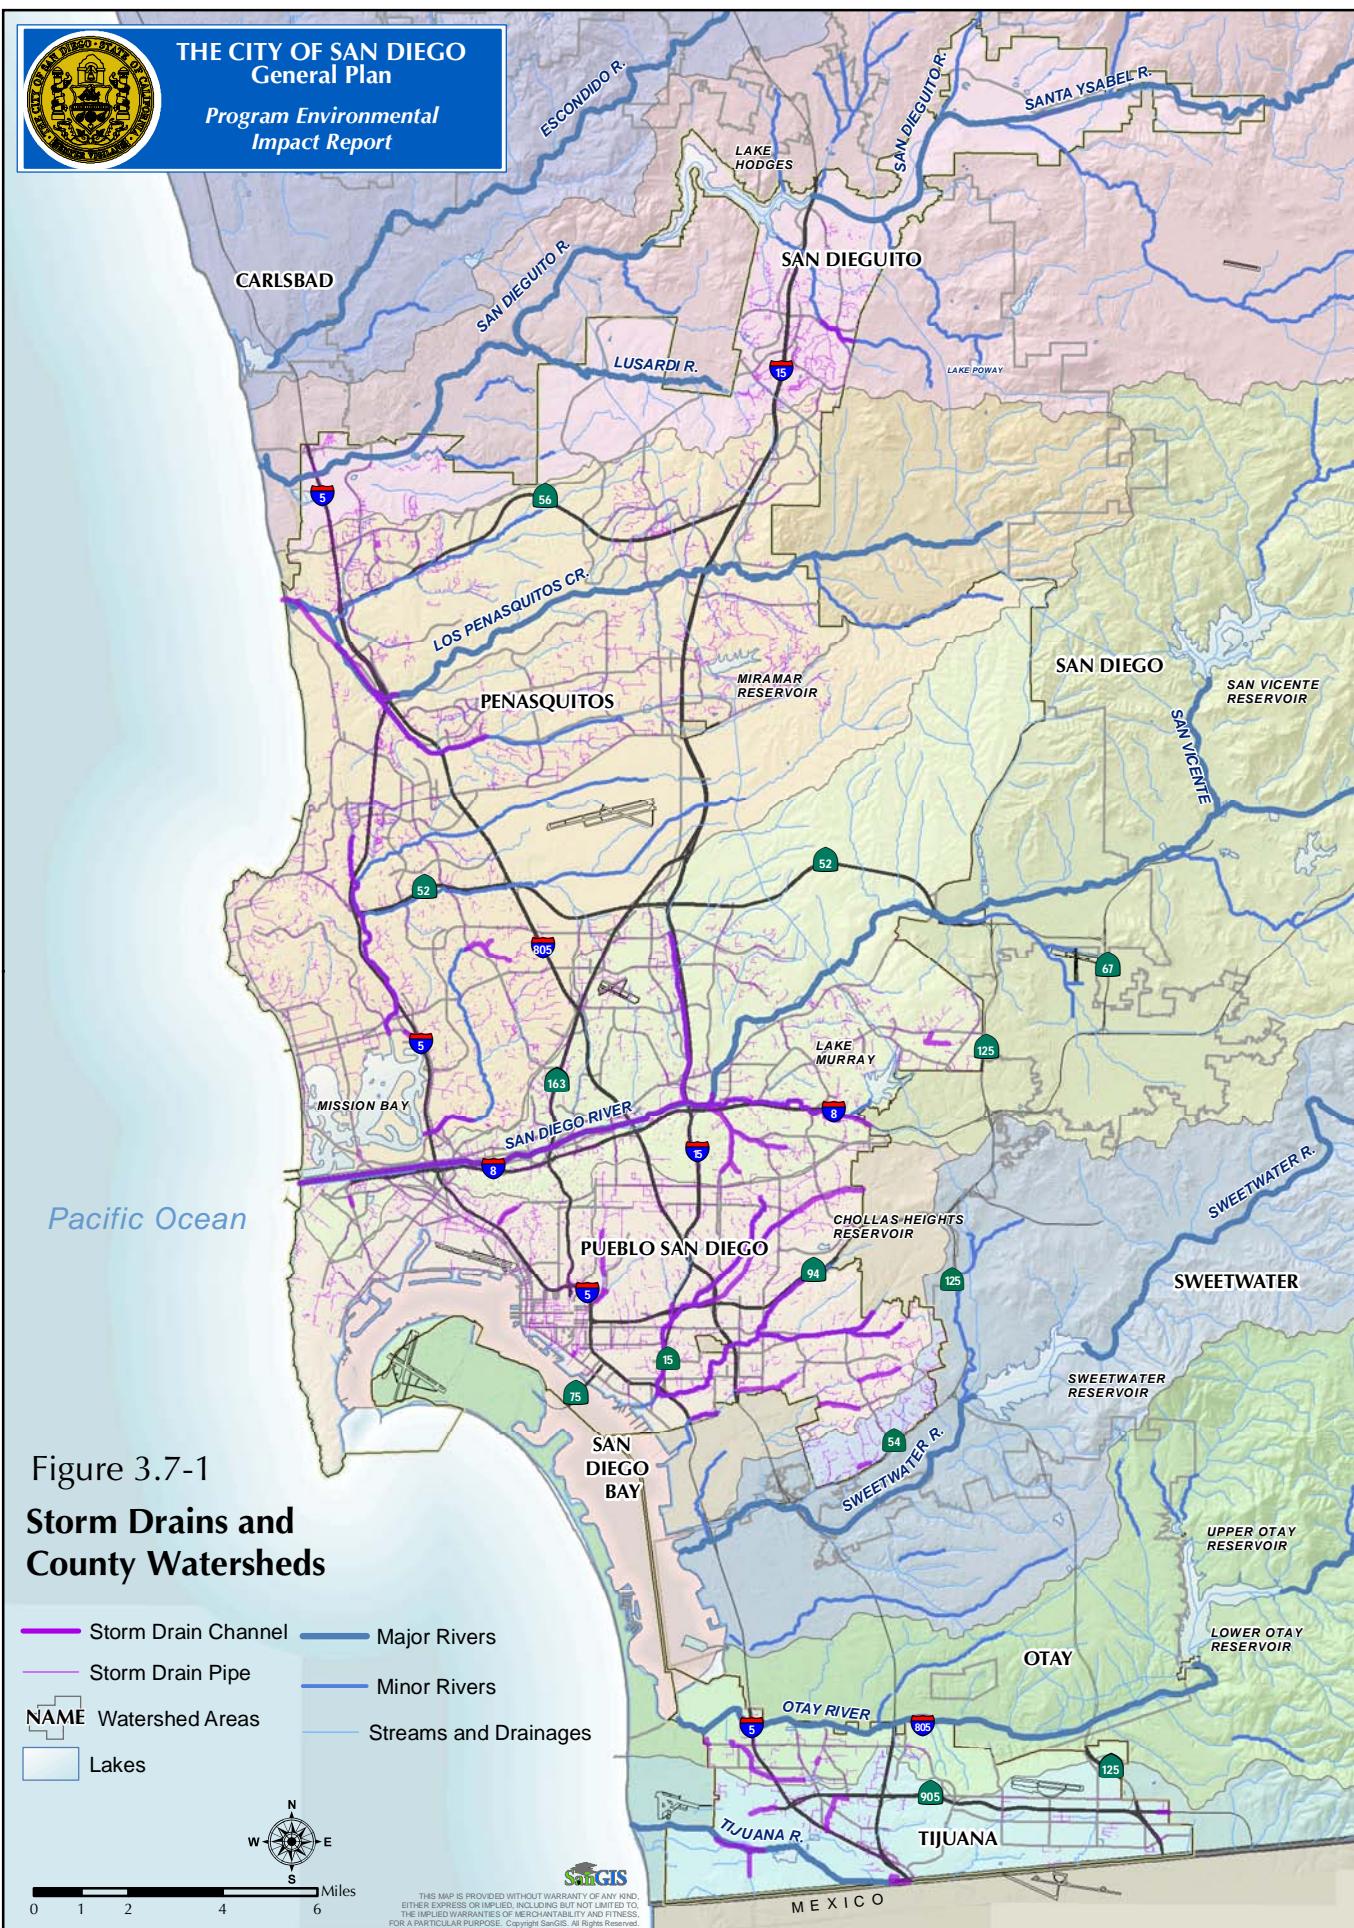

THE CITY OF SAN DIEGO
General Plan
*Program Environmental
Impact Report*

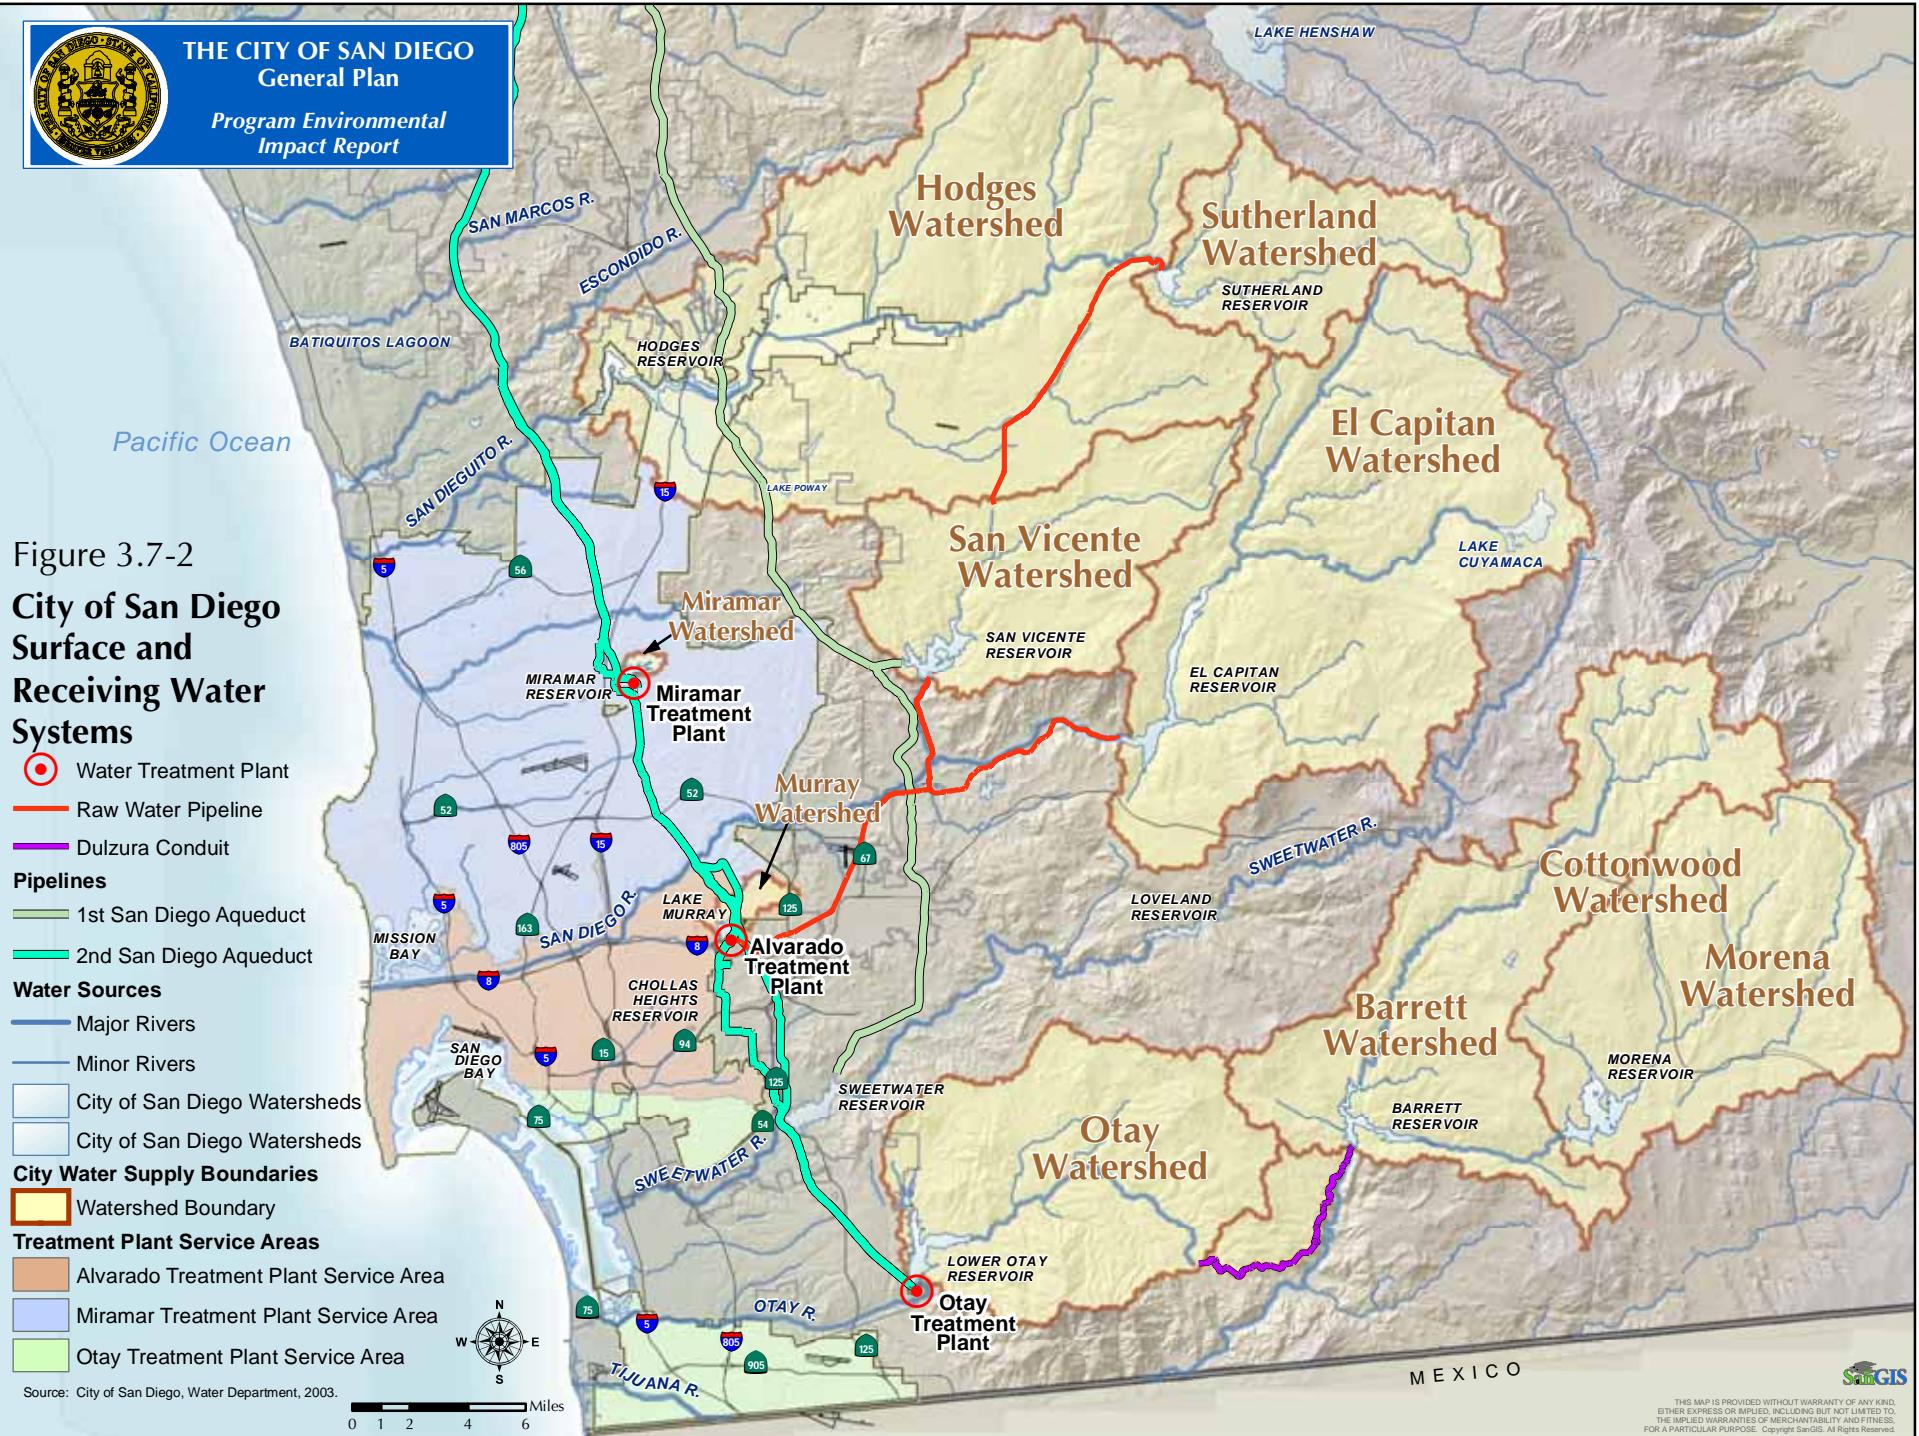


Figure 3.7-2
City of San Diego
Surface and
Receiving Water
Systems

● Water Treatment Plant
— Raw Water Pipeline

— Dulzura Conduit

Pipelines

— 1st San Diego Aqueduct

— 2nd San Diego Aqueduct

Water Sources

— Major Rivers

— Minor Rivers

— City of San Diego Watersheds

— City of San Diego Watersheds

City Water Supply Boundaries

— Watershed Boundary

Treatment Plant Service Areas

— Alvarado Treatment Plant Service Area

— Miramar Treatment Plant Service Area

— Otay Treatment Plant Service Area

Source: City of San Diego, Water Department, 2003.

0 1 2 4 6 Miles

THIS MAP IS PROVIDED WITHOUT WARRANTY OF ANY KIND,
EITHER EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO,
THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS
FOR A PARTICULAR PURPOSE. Copyright SanGIS. All Rights Reserved.
9/14/2007 - 12:29:03 PM